


NOTE:
DESIRABLE LOCATION OF FIRE HYDRANT SHALL BE
AT COMMON PROPERTY LINE, 8 FEET AWAY FROM
DRIVEWAYS, A MINIMUM OF 2 FEET FROM
SIDEWALKS, OR APPROVED BY THE VILLAGE
ENGINEER.
THE AUXILIARY VALVE SHALL NOT BE LOCATED
WITHIN THE SIDEWALK

BACK OF CURB OR
EDGE OF PAVEMENT
IF NO CURB EXISTS

PROPOSED FIRE HYDRANT

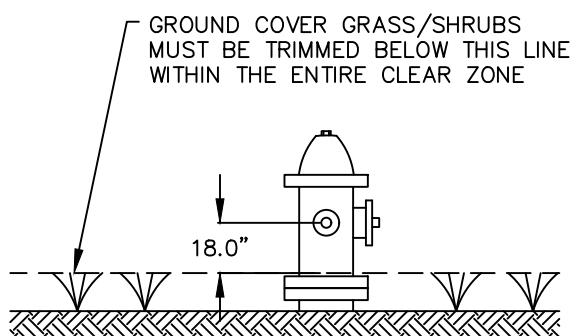

CLEAR ZONE DENOTED BY CROSS HATCHING;
CLEAR ZONE SHALL BE FREE OF TREES, ROCKS, SHRUBS,
OBSTRUCTIONS ETC.
FOR FIRE DEPARTMENT ACCESS.

FIRE HYDRANT CLEARANCE DETAIL



northbrook
Public Works Department

DATE	REVISIONS
1-9-19	Revised Notes
4-1-21	Revised Notes

STANDARD DETAIL
W-2 (02)