



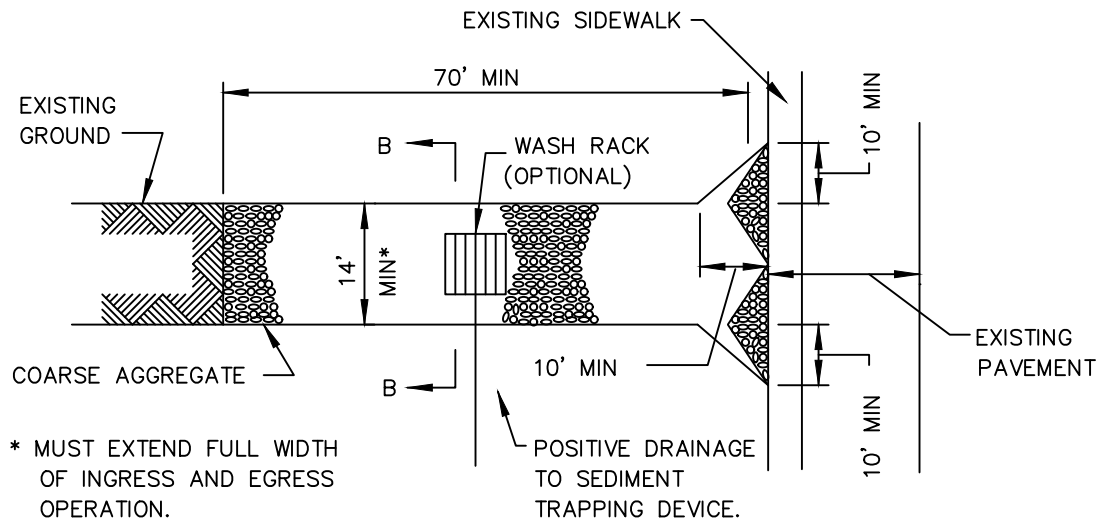

PLAN VIEW

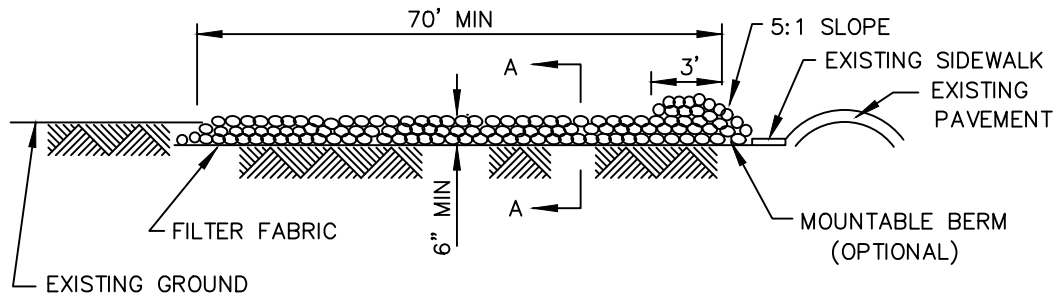


SIDE ELEVATION

NOTES:


1. FILTER FABRIC SHALL MEET THE REQUIREMENTS OF MATERIAL SPECIFICATION 592 GEOTEXTILE, TABLE I OR 2, CLASS I , II OR IV AND SHALL BE PLACED OVER THE CLEARED AREA PRIOR TO THE PLACING OF ROCK.
2. ROCK SHALL MEET ONE OF THE FOLLOWING GRADATIONS: AHTD AGGREGATE BASE COURSE CLASS 1,2 OR 3, OR ASTM C33 COARSE AGGREGATE SIZE 1, 2, 3, 357, 4 OR 467, AND BE PLACED ACCORDING TO CONSTRUCTION SPECIFICATION 25 ROCKFILL USING PLACEMENT METHOD 1 AND CLASS III COMPACTION.
3. ANY DRAINAGE FACILITIES REQUIRED BECAUSE OF WASHING SHALL BE CONSTRUCTED ACCORDING TO MANUFACTURERS SPECIFICATIONS.
4. IF WASH RACKS ARE USED THEY SHALL BE INSTALLED ACCORDING TO THE MANUFACTURES SPECIFICATIONS.

STABILIZED CONSTRUCTION ENTRANCE DETAIL

DATE	REVISIONS
5-1-23	New Detail

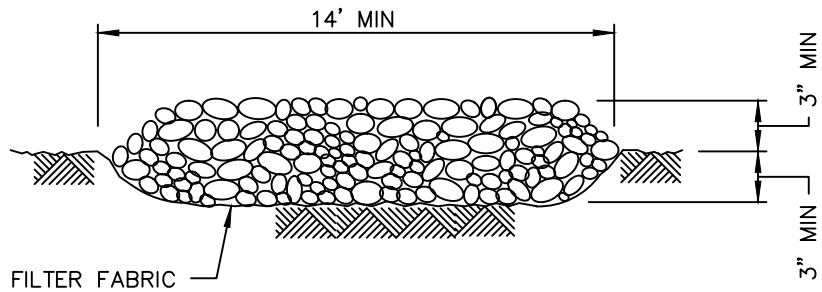

SECTION A-A

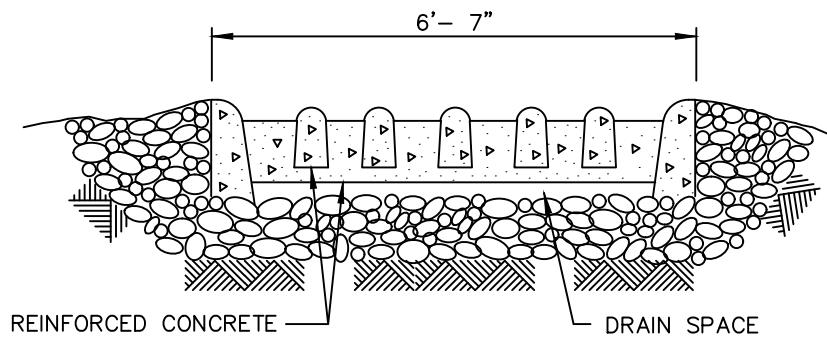

SECTION B-B

STABILIZED CONSTRUCTION ENTRANCE DETAIL

DATE	REVISIONS
5-1-23	New Detail