


2-#6 (3/4") EPOXY-COATED SMOOTH DOWEL BARS WITH GREASED CAPS ARE TO BE INSTALLED AT ALL EXPANSION JOINTS

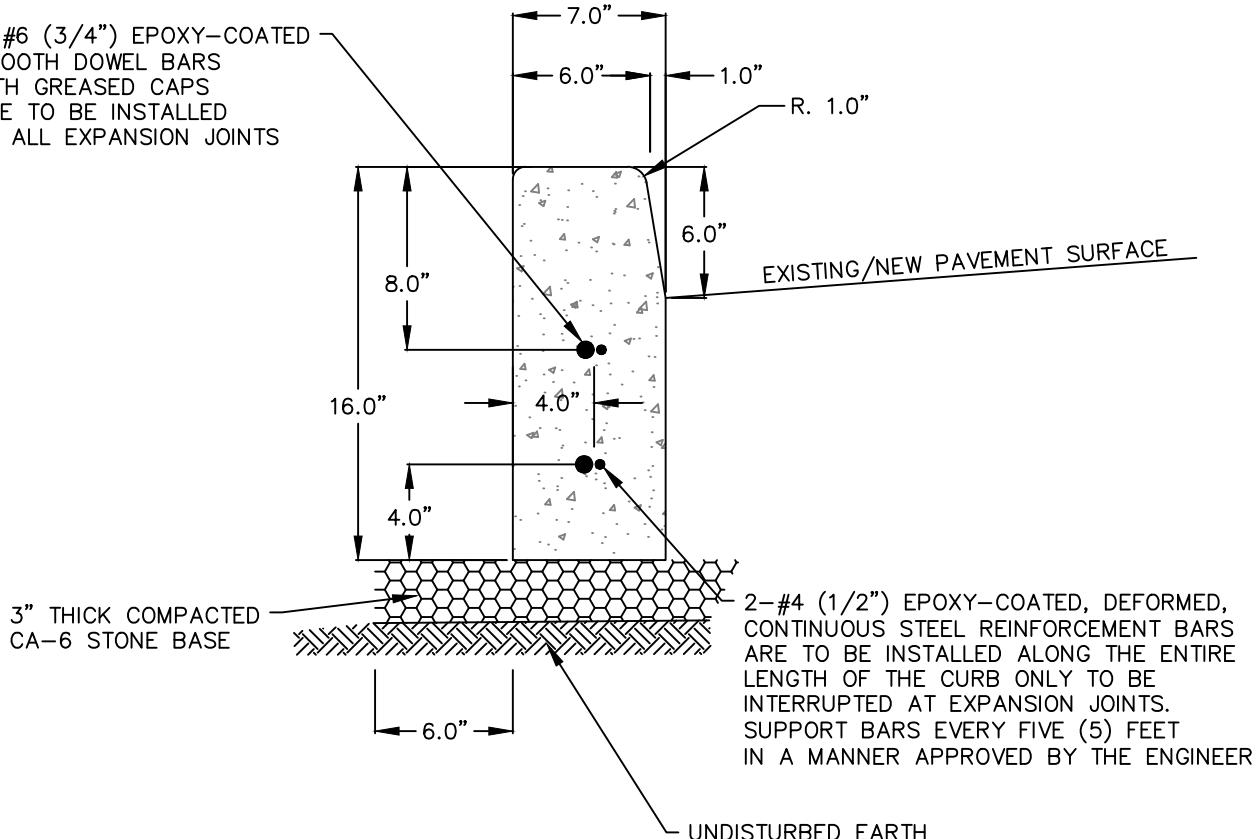

NOTES:

1. EXPANSION JOINTS ARE TO BE CONSTRUCTED AT 60' INTERVALS WITH 3/4" FIBER EXPANSION JOINT PER ASTM D-1751, AND AT ADDITIONAL LOCATIONS AS SPECIFIED BY THE ENGINEER.
2. CONTRACTION JOINTS ARE TO BE CONSTRUCTED AT 15' INTERVALS AND AT ADDITIONAL LOCATIONS AS SPECIFIED BY THE ENGINEER

TYPE B CURB DETAIL



northbrook
Public Works Department

DATE	REVISIONS
4-30-20	Revised Notes
4-1-21	Changed Dowel Bar Size Required

STANDARD DETAIL
P-2 (02)